




MAIN FLOOR LAYOUT

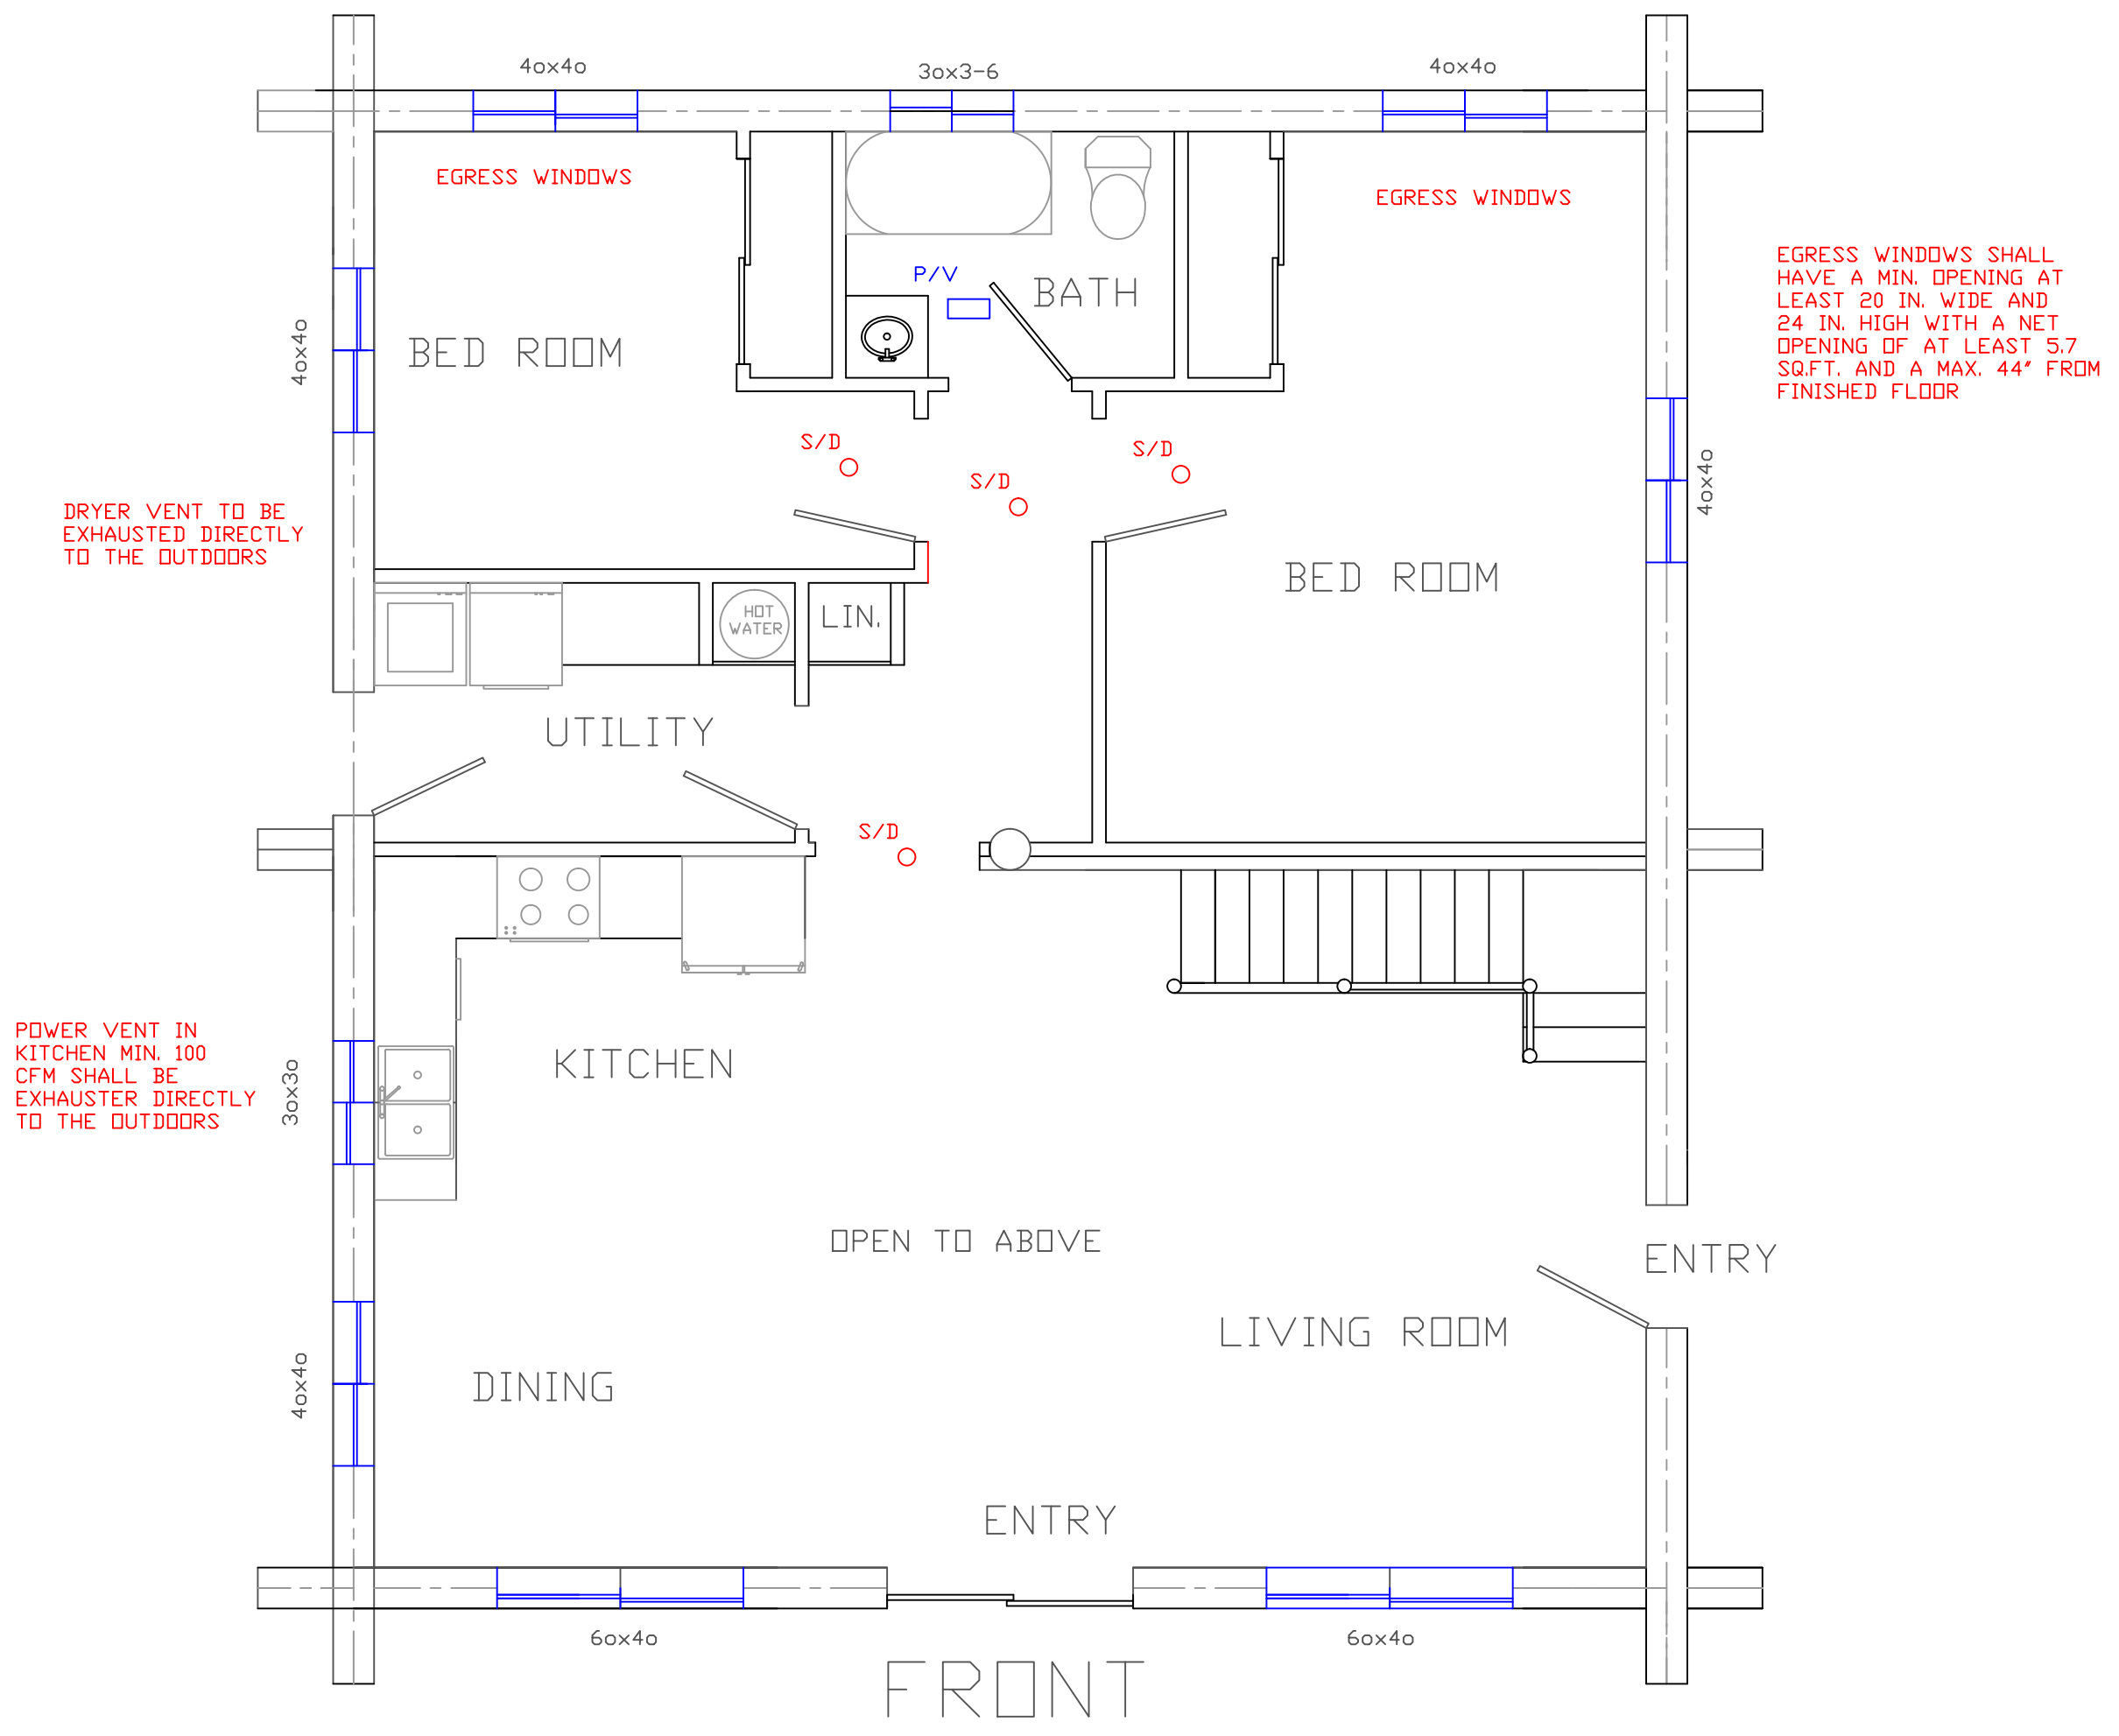


LOFT

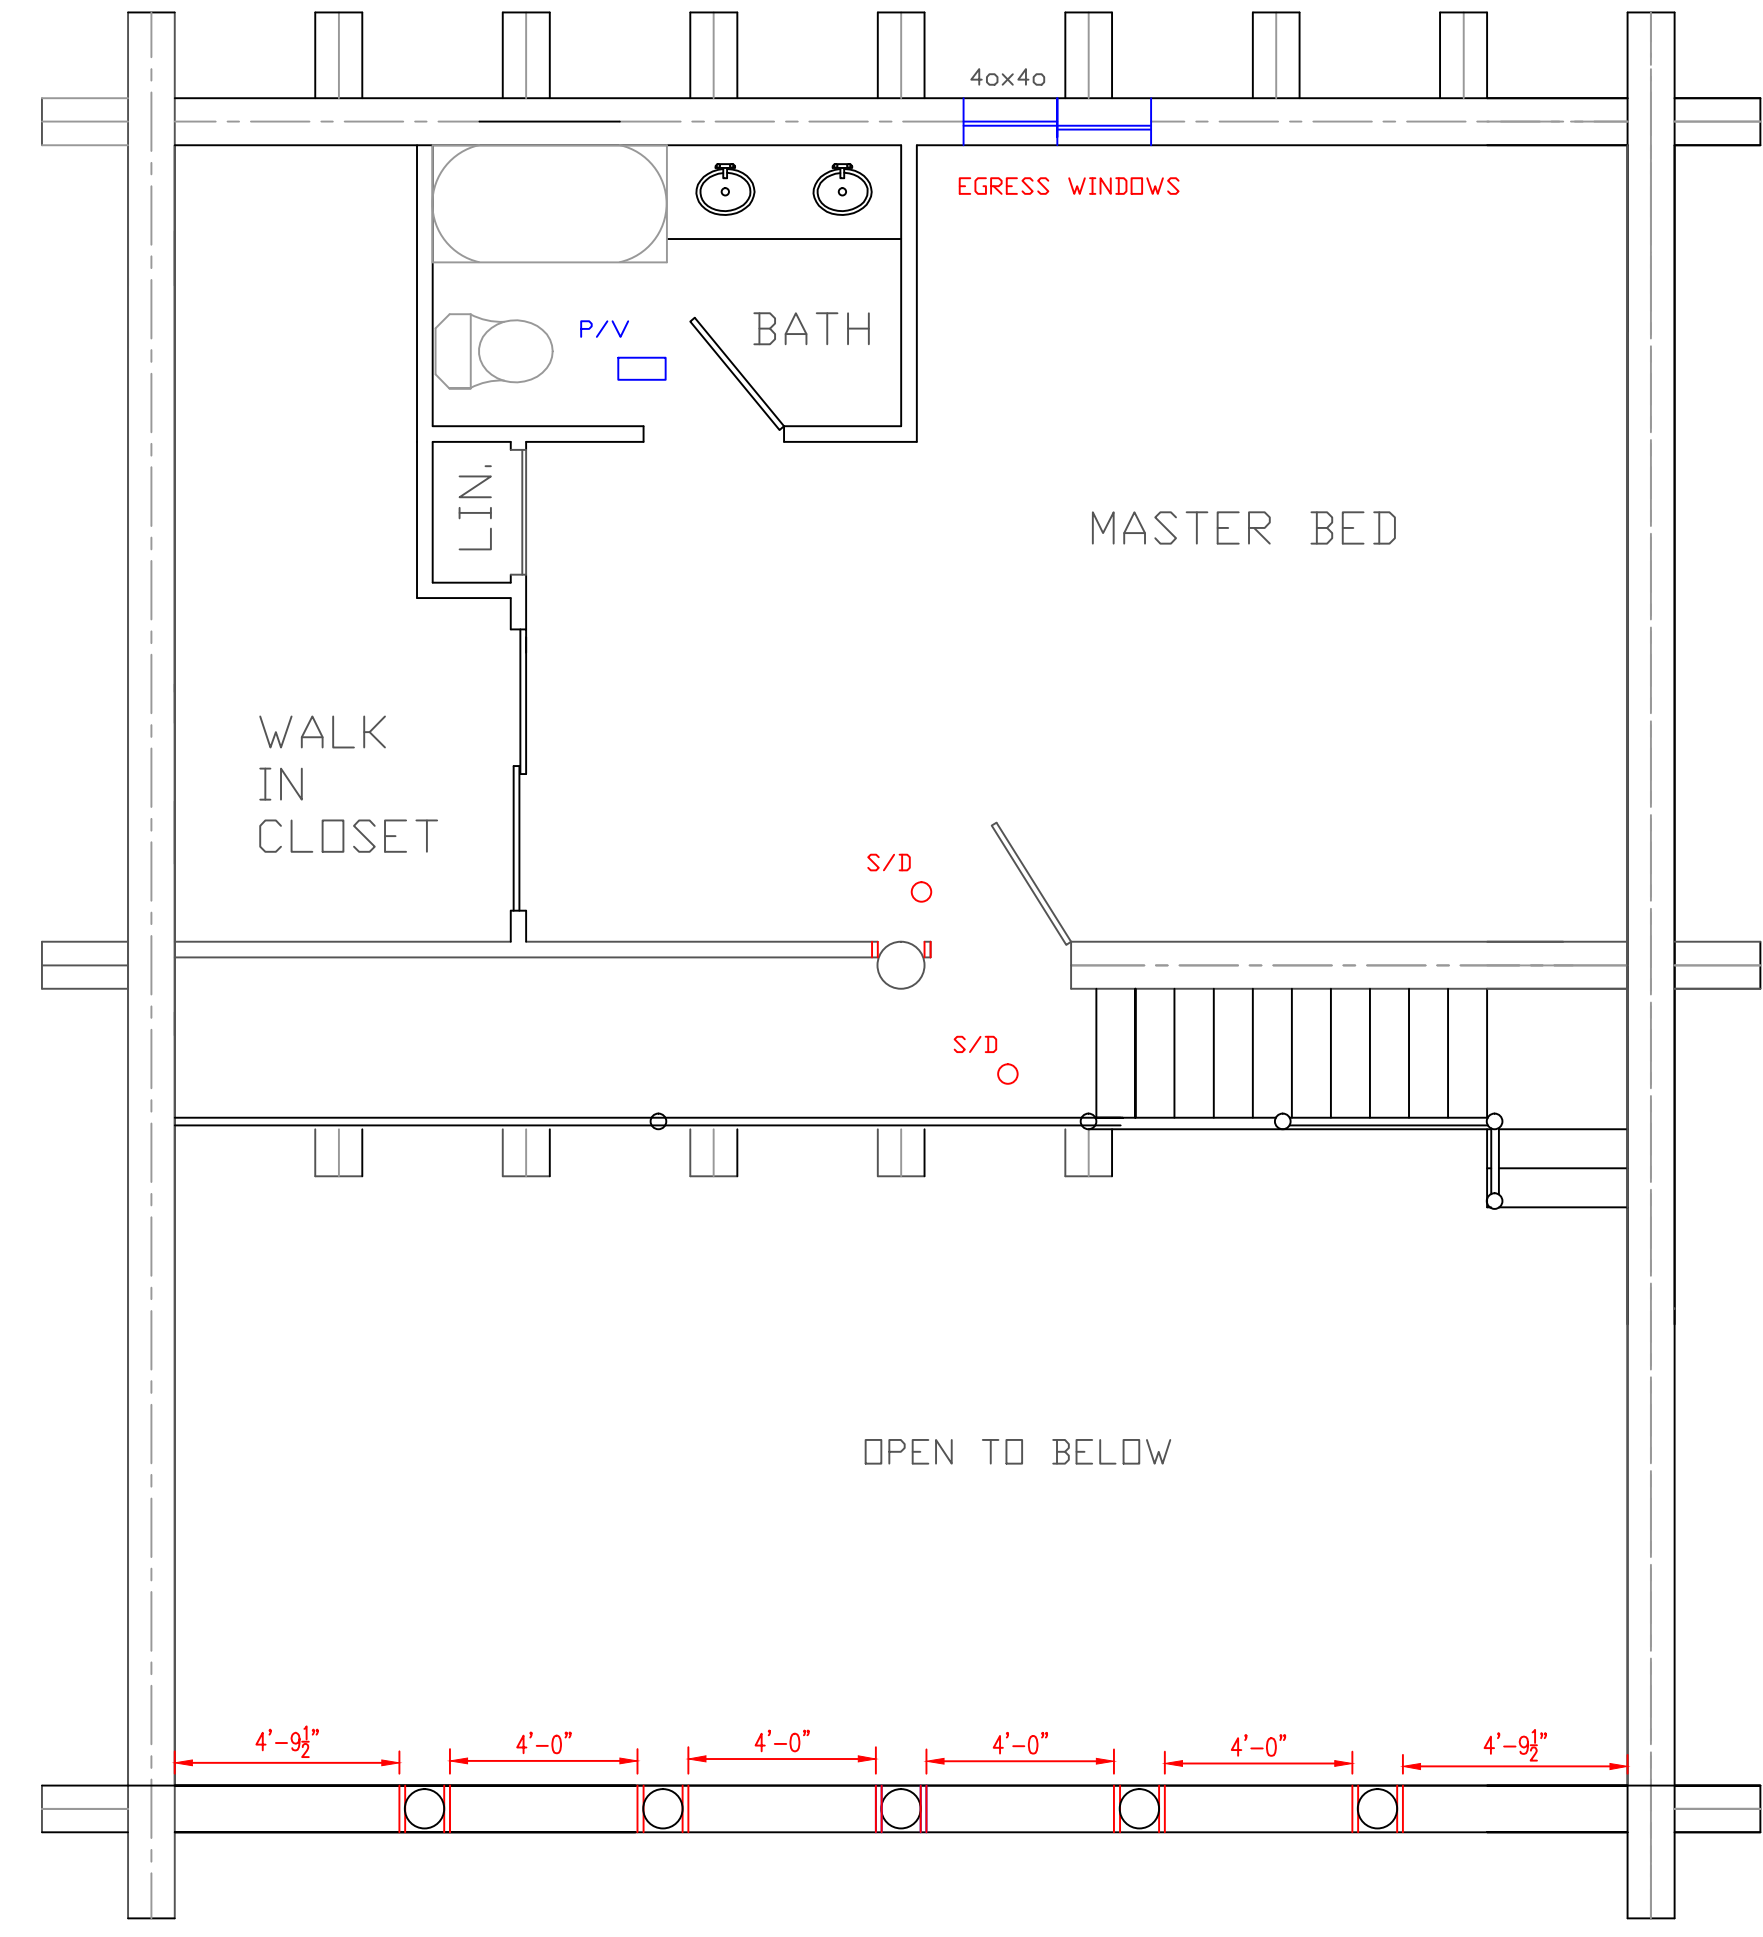

LOFT DECKING

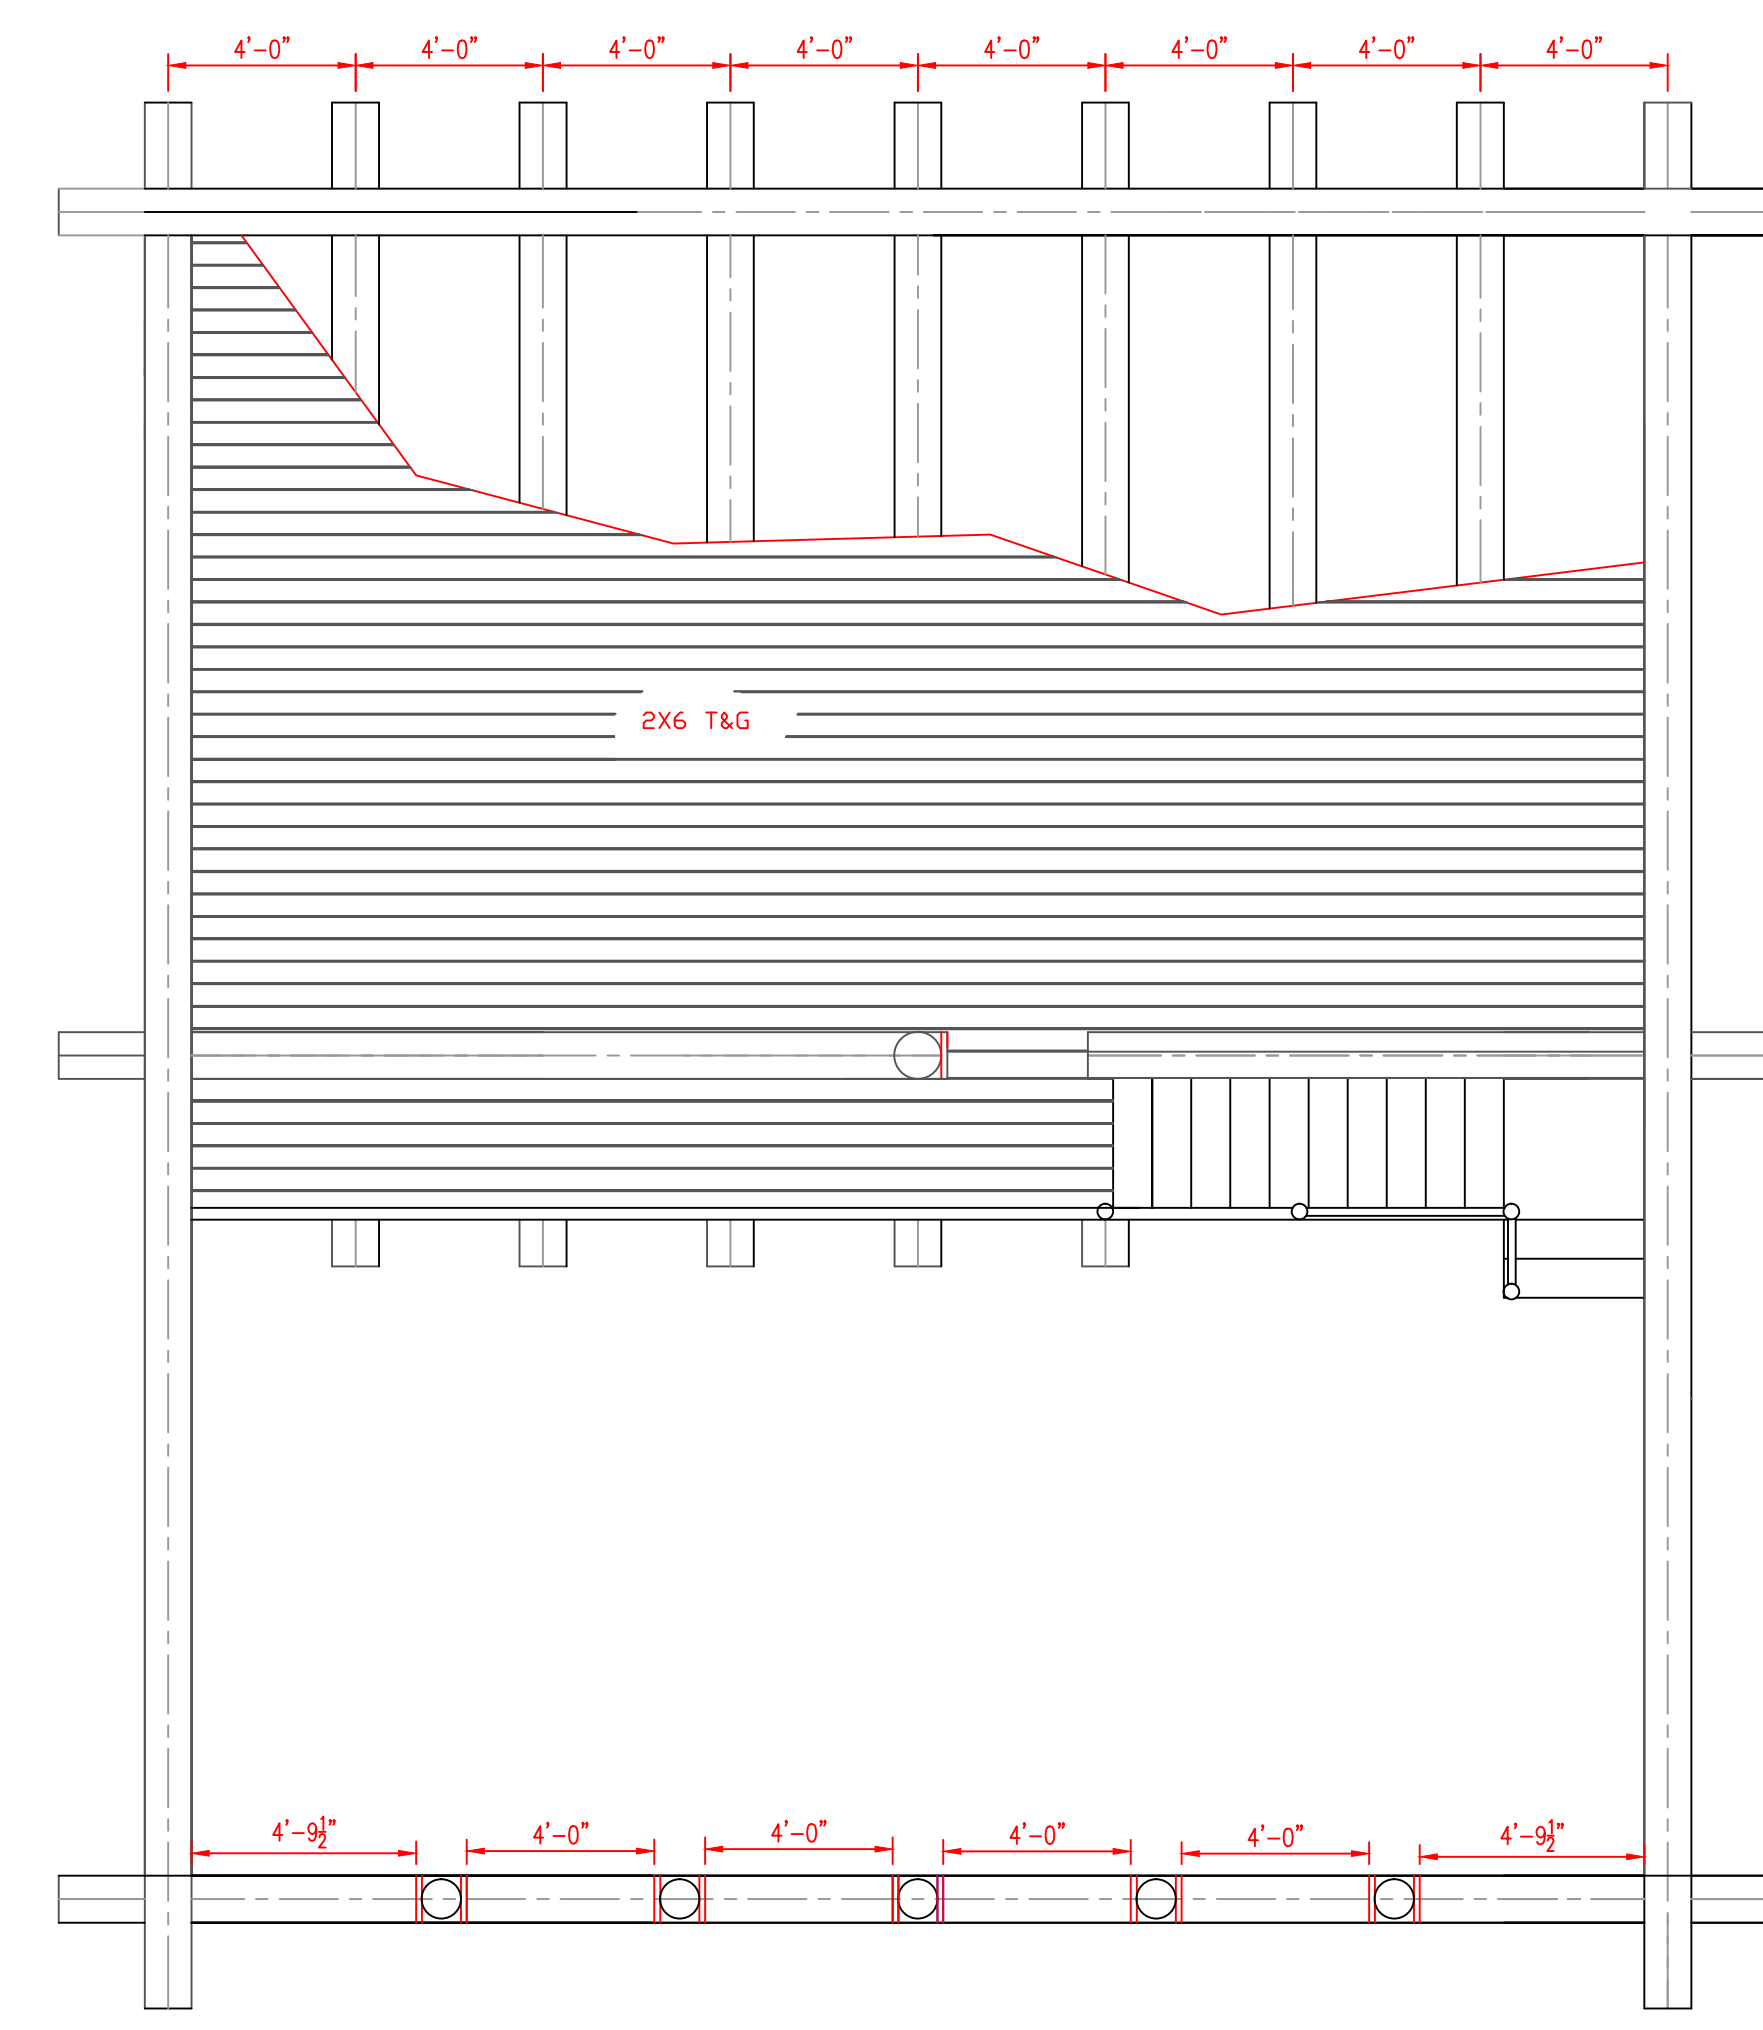

CROSS SECTION

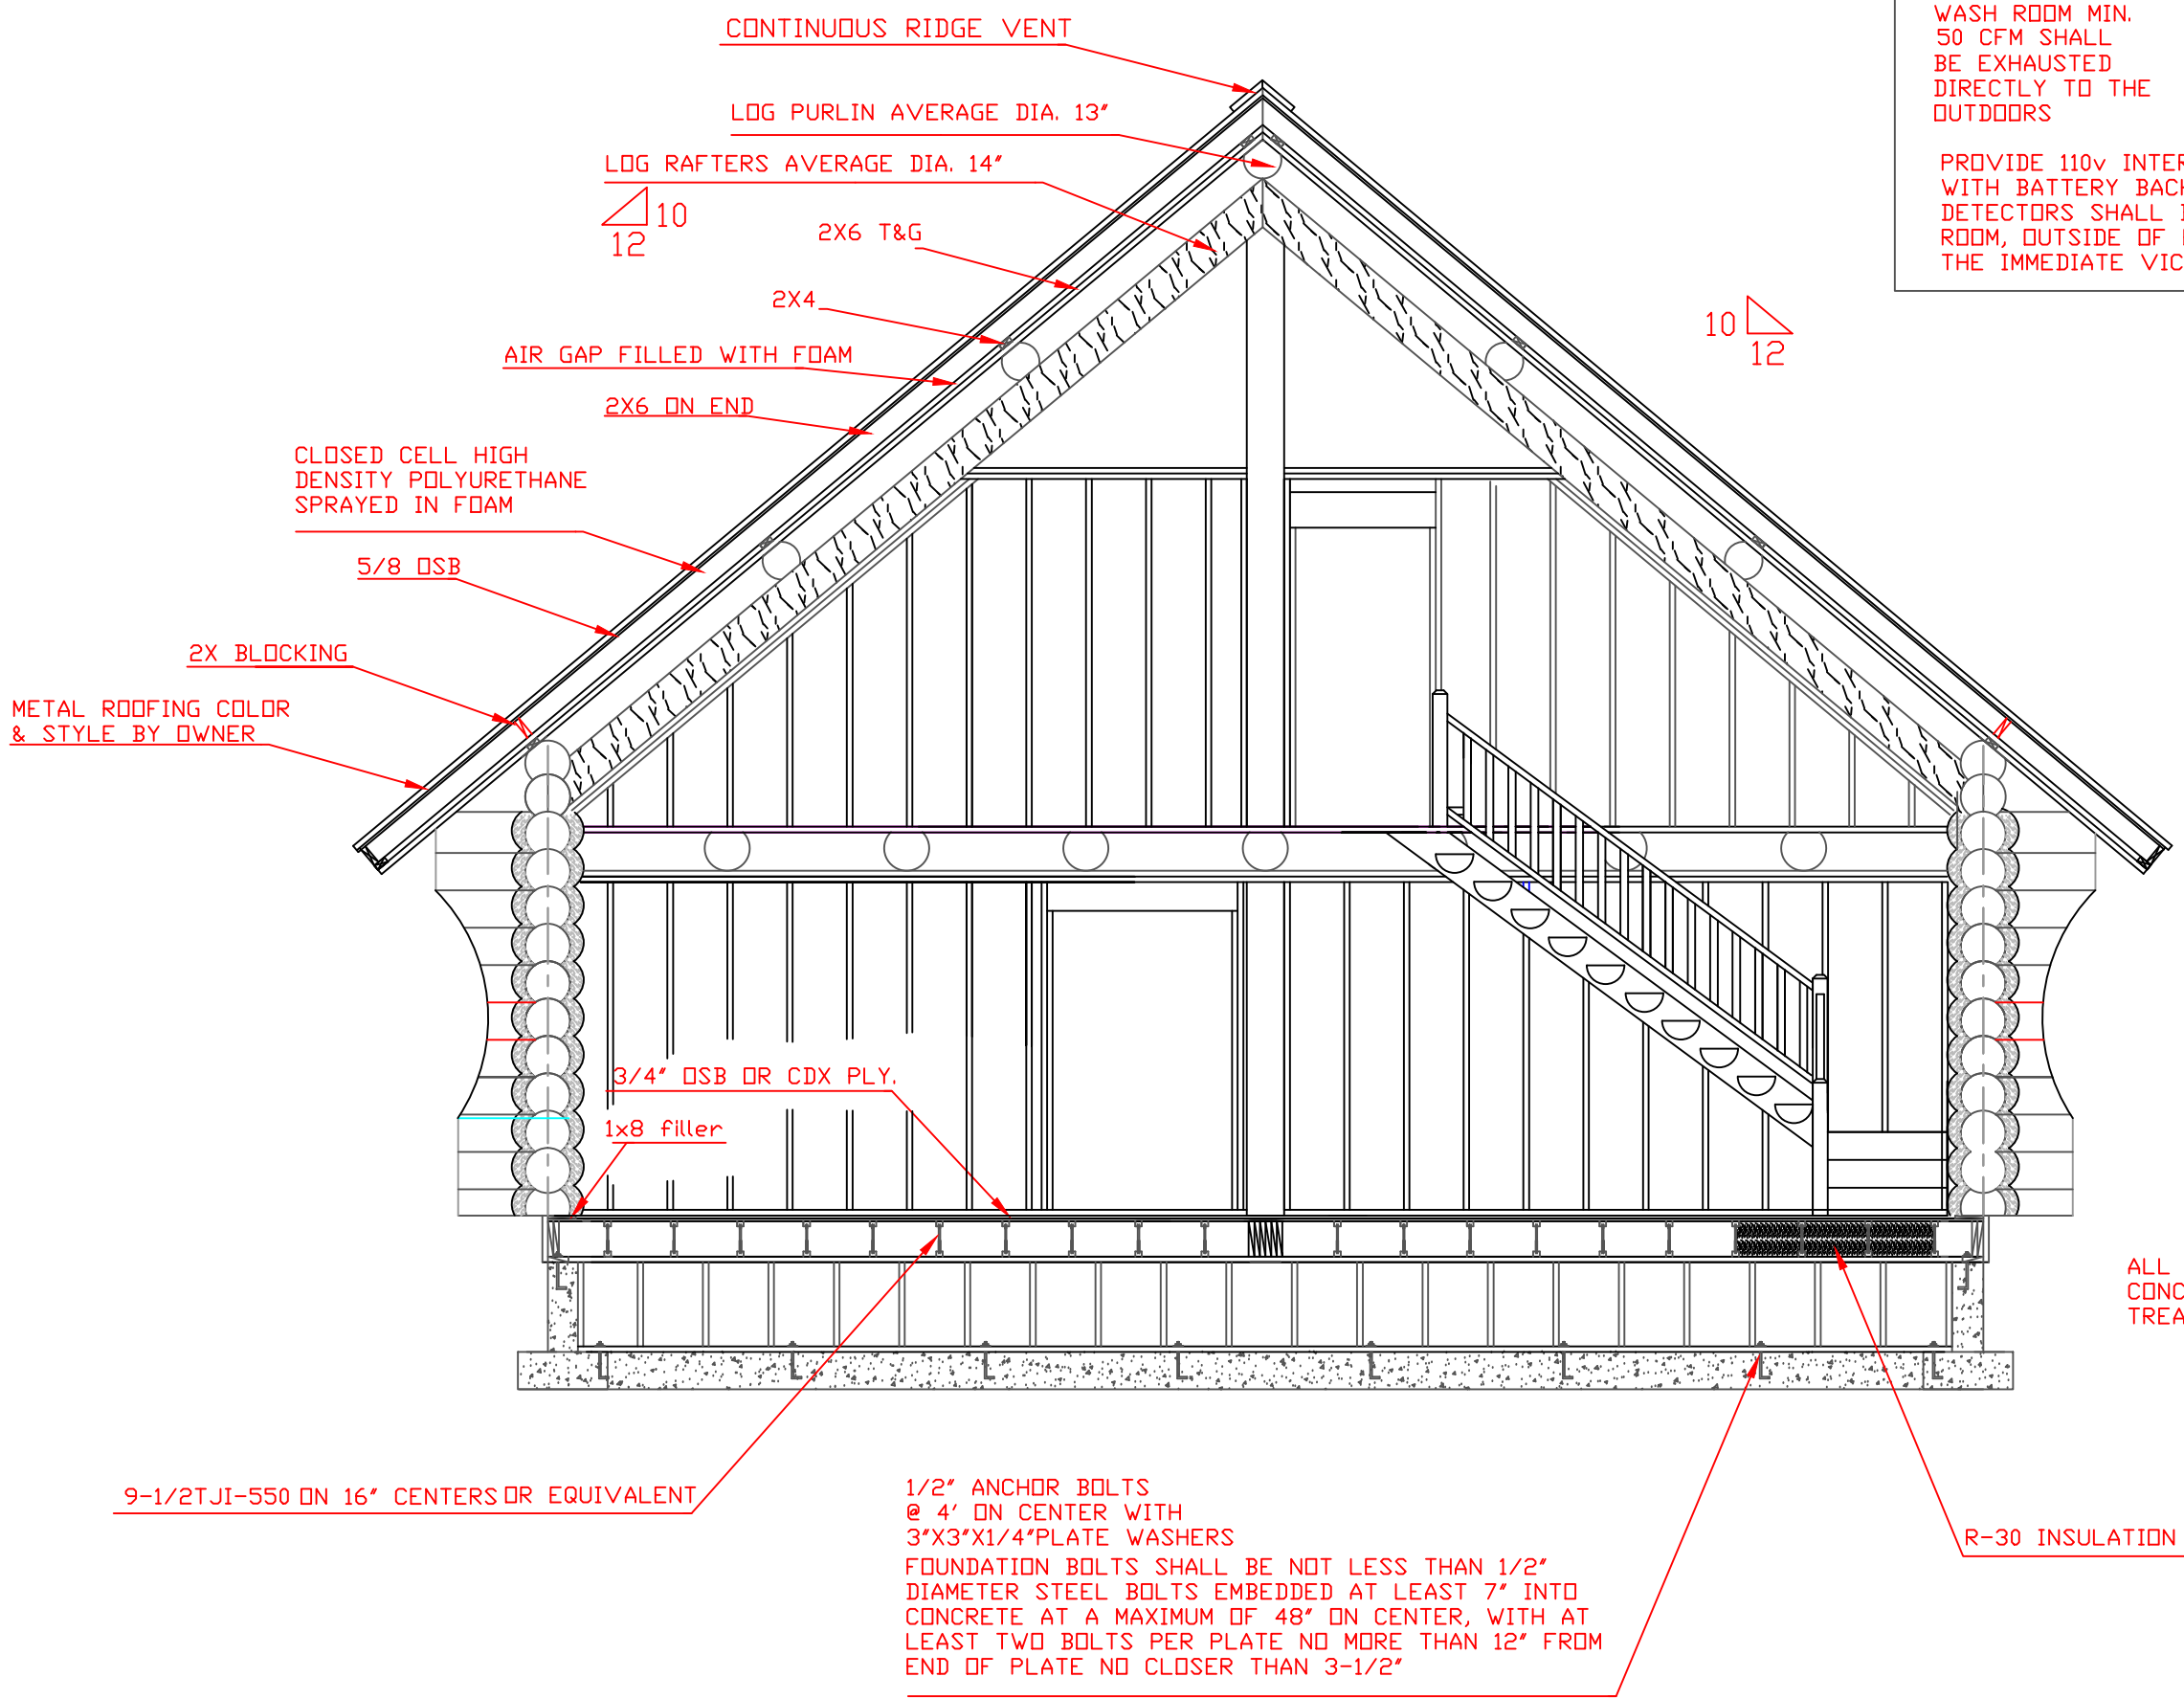


Legend:
 P/V POWER VENT
 S/D SMOKE DETECTOR

POWER VENT IN WASH ROOM MIN. 50 CFM SHALL BE EXHAUSTED DIRECTLY TO THE OUTDOORS.

PROVIDE 110V INTERCONNECTED SMOKE DETECTORS WITH BATTERY BACKUP AT ALL FLOOR LEVELS. SMOKE DETECTORS SHALL BE INSTALLED IN EACH SLEEPING ROOM, OUTSIDE OF EACH SEPARATE SLEEPING AREA, IN THE IMMEDIATE VICINITY OF BEDROOMS.

STAIRS LAY OUT

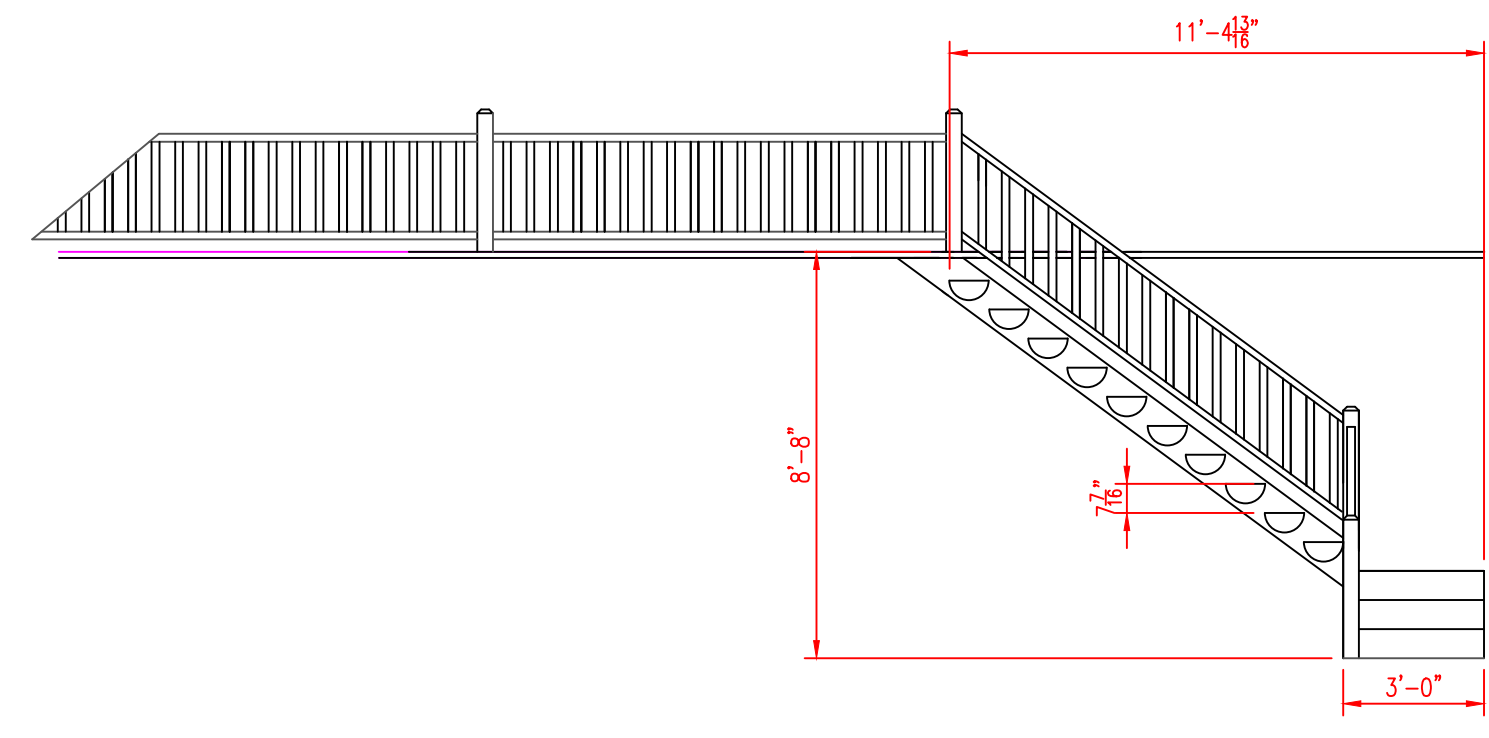

GUARDRAILS

HANDRAILS ON STAIRWAYS WITH FOUR OR MORE RISERS

GUARDRAILS SHALL BE CONFIGURED SO THAT A 4\"/>

GUARDRAILS ON STAIRS SHALL BE CONFIGURED SO THAT A 4-3/8\"/>

THE TRIANGULAR SPACE BETWEEN GUARDRAIL AND STAIR SHALL BE CONFIGURED SO THAT A 6\"/>

STAIRWAY REQUIREMENTS

6'8\"/>

MAX 38\"/>

MIN. TREAD LENGTH 10\"/>

MIN. 10\"/>

3/4\"/>

7-3/4\"/>


MAX. RISER HEIGHT 7-3/4\"/>

NOSING REQUIRED ON TREADS LESS THAN 11\"/>

MAX. TREAD RUN VARIATION 3/8\"/>

MAX. RISER VARIATION 3/8\"/>

SCALE X2

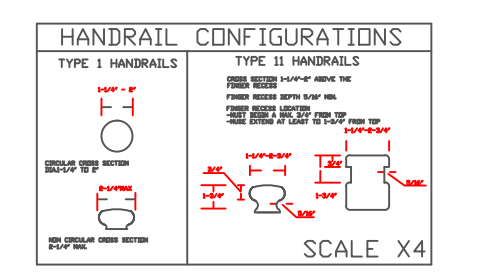

CLEARWATER LOG

32'x36'

SCALE 1/4\"/>

DESIGN BY MARK VESIK

E-MAIL mavesik@yahoo.com

WEB-SITE www.mvprints.net

208-451-0221